


CLIENT:	Greely Sand & Gravel	DESCRIPTION:	Fine Aggregate	FILE NO:	PM0754
CONTRACT NO.:	-	SPECIFICATION:	Decomposed Granite	LAB NO:	15401
PROJECT:	Laboratory Testing	INTENDED USE:	-	DATE RECEIVED:	5-May-20
DATE SAMPLED:	5-May-20	PIT OR QUARRY:	Pit	DATE TESTED:	7-May-20
SAMPLED BY:	Client	SOURCE LOCATION:	-	DATE REPORTED:	8-May-20
		SAMPLE LOCATION:	-	TESTED BY:	DK

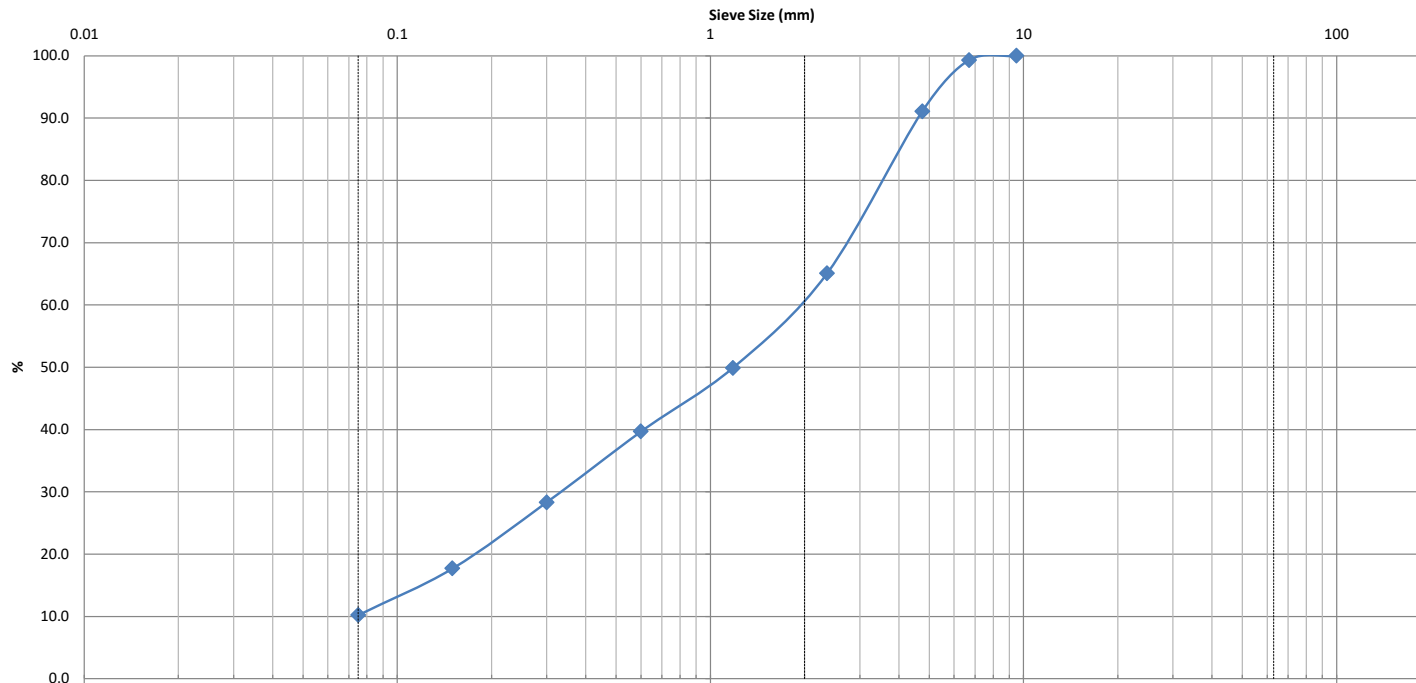

Silt and Clay	Sand			Gravel		Cobble
	Fine	Medium	Coarse	Fine	Coarse	

Identification	Soil Classification					MC(%)	LL	PL	PI	Cc	Cu
	D100	D60	D30	D10	Gravel (%)	Sand (%)	Silt (%)	Clay (%)	0.79	26.0	
	9.5	1.95	0.34	0.075	8.9	80.9	10.2				

Comments:

REVIEWED BY:	Curtis Beadow	Joe Fosyth, P. Eng.
	<i>Curtis Beadow</i>	<i>Joe Fosyth</i>

CLIENT: Greely Sand & Gravel	DESCRIPTION: Fine Aggregate	FILE NO.: PM0754
CONTRACT NO.: -	SPECIFICATION: Decomposed Granite	LAB NO.: 15401
PROJECT: Laboratory Testing	INTENDED USE: -	DATE REC'D: 5-May-20
	PIT OR QUARRY: Pit	DATE TESTED: 7-May-20
DATE SAMPLED: 5-May-20	SOURCE LOCATION: -	DATE REP'D: 8-May-20
SAMPLED BY: Client	SAMPLE LOCATION: -	TESTED BY: DK

WEIGHT BEFORE WASH	355.5
---------------------------	-------

WEIGHT AFTER WASH	330.3
--------------------------	-------

SIEVE SIZE (mm)	WEIGHT RETAINED	PERCENT RETAINED	PERCENT PASSING	LOWER SPEC	UPPER SPEC	REMARK
150						
106						
75						
63						
53						
37.5						
26.5						
19						
16						
13.2						
9.5	0.0	0.0	100.0			
6.7	2.4	0.7	99.3			
4.75	31.8	8.9	91.1			
2.36	124.0	34.9	65.1			
1.18	178.0	50.1	49.9			
0.6	214.4	60.3	39.7			
0.3	254.8	71.7	28.3			
0.15	292.7	82.3	17.7			
0.075	319.3	89.8	10.2			
PAN	330.3					

SIEVE CHECK FINE	0.00	0.3% max.	REFERENCE MATERIAL
------------------	------	-----------	---------------------------

OTHER TESTS	RESULT	LAB NO.	RESULT

REVIEWED BY:	Curtis Beadow	Joe Forsyth, P. Eng.
	